



Austrian Institute of Construction Engineering
Schenkenstrasse 4 | T+43 1 533 65 50
1010 Vienna | Austria | F+43 1 533 64 23
www.oib.or.at | mail@oib.or.at



European Technical Assessment

ETA-13/0093
of 23.08.2018

General part

Technical Assessment Body issuing the European Technical Assessment

Österreichisches Institut für Bautechnik (OIB)
Austrian Institute of Construction Engineering

Trade name of the construction product

ZZ C30

Product family to which the construction product belongs

Fire Stopping and Fire Sealing Products:
Penetration Seals

Manufacturer

Karl Zimmermann
Miltzstraße 29
51061 Köln
GERMANY

Manufacturing plant

Karl Zimmermann GmbH
Marconistraße 7-9
50769 Köln
GERMANY

This European Technical Assessment contains

18 pages including Annexes A-1 to D-1 which form an integral part of this assessment

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of

European Assessment Document
EAD 350454-00-1104 „Fire stopping and fire sealing products – Penetration seals”

This European Technical Assessment replaces

European technical approval ETA-13/0093 with validity from 28.06.2013 to 27.06.2018

This European Technical Assessment is not to be transferred to manufacturers or agents of manufacturer other than those indicated on page 1, or manufacturing plants other than those laid down in the context of this European Technical Assessment.

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction can be made with the written consent of the Österreichisches Institut für Bautechnik. In this case, partial reproduction has to be designated as such.

This European Technical Assessment may be withdrawn by the Österreichisches Institut für Bautechnik, in particular pursuant to information by the Commission according to Article 25 (3) of Regulation (EU) No 305/2011.

electronic copy
electronic copy
electronic copy
electronic copy
electronic copy
electronic copy
electronic copy

Specific parts

1 Technical description of the product

“ZZ C30” is a product to be used as cable penetration seal based on the intumescent fire protection sealant “ZZ 333”.

Component of “ZZ C30”	Characteristics
ZZ 333	Intumescent pasty, brushable mastic on the basis of acrylate

2 Specification of the intended use(s) in accordance with the applicable European Assessment Document (hereinafter EAD)

2.1 Intended use

“ZZ C30” is intended to be used as a cable penetration seal to temporarily or permanently reinstate the fire resistance performance of flexible wall constructions, rigid wall constructions and rigid floor constructions where they have been provided with apertures which are penetrated by various cables.

The thickness of the penetration seal has to be minimum 100 mm or 150 mm consisting of one layer of at least 15 mm or 50 mm “ZZ 333” (depending on the fire resistance classification; see Annex D-1 of the ETA) on both sides of the separating element.

The maximum opening size of the penetration seal has to comply with the dimensions as specified in the following table.

Blank penetration seals with maximum opening sizes as specified in the following table have been tested.

“ZZ C30” can be installed only in the types of separating elements as specified in the following table.

3 Performance of the product and references to the methods used for its assessment

Basic requirements for construction works	Essential characteristic	Method of verification	Performance
BWR 2	Reaction to fire	EN 13501-1:2007+A1:2009	Clause 3.1.1 of the ETA
	Resistance to fire	EN 13501-2:2007+A1:2009	Clause 3.1.2 of the ETA and Annex D-1 of the ETA
BWR 3	Air permeability	EN 1026:2016	Clause 3.2.1 of the ETA
	Water permeability	No performance assessed	
	Content, emission and/or release of dangerous substances	EAD 350454-00-1104 clause 2.2.5	Clause 3.2.3 of the ETA
BWR 4	Mechanical resistance and stability	No performance assessed	
	Resistance to impact / movement	No performance assessed	
	Adhesion	No performance assessed	
	Durability	EAD 350454-00-1104 clause 2.2.9	Clause 3.3.4 of the ETA
BWR 5	Airborne sound insulation	No performance assessed	
BWR 6	Thermal properties	No performance assessed	
	Water vapour permeability	No performance assessed	

3.1 Safety in case of fire (BWR 2)

3.1.1 Reaction to fire

The components of “ZZ C30” were assessed according to EAD 350454-00-1104 clause 2.2.1 and classified according to EN 13501-1:2007+A1:2009.

Component	Class according to EN 13501-1:2007+A1:2009
ZZ 333	E

3.1.2 Resistance to fire

“ZZ C30” was tested according to EAD 350454-00-1104 clause 2.2.2 and EN 1366-3:2009 in conjunction with EN 1363-1:1999.

Based upon the gained test results and the field of application specified within EN 1366-3:2009 “ZZ C30” has been classified according to EN 13501-2:2007+A1:2009. The individual fire resistance classes are listed in Annex D-1 of the ETA.

The resistance to fire classification listed in Annex D-1 of the ETA is only valid if “ZZ C30” is installed according to Annex A-1 to A-4 of the ETA.

3.4 Protection against noise (BWR 5)

3.4.1 Airborne sound insulation
No performance assessed.

3.5 Energy economy and heat retention (BWR 6)

3.5.1 Thermal properties
No performance assessed.

3.5.2 Water vapour permeability
No performance assessed.

4 Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base

4.1 AVCP system

According to the Decision 1999/454/EC⁵, amended by Decision 2001/596/EC⁶ of the European Commission the system of assessment and verification of constancy of performance (see Annex V of Regulation (EU) No 305/2011) is given in the following table.

Product(s)	Intended use(s)	Level(s) or class(es) (resistance to fire)	System of assessment and verification of constancy of performance
Fire Stopping and Fire Sealing Products	for fire compartmentation and/or fire protection or fire performance	any	1

In addition, according to the Decision 1999/454/EC, amended by Decision 2001/596/EC of the European Commission the system(s) of assessment and verification of constancy of performance, with regard to reaction to fire, is given in the following table.

Product(s)	Intended use(s)	Level(s) or class(es) (reaction to fire)	System of assessment and verification of constancy of performance
Fire Stopping and Fire Sealing Products	for uses subject to regulations on reaction to fire	A1*, A2*, B*, C*	1
		A1**, A2**, B**, C**, D, E	3
		(A1 to E)***, F	4

* Products/materials for which a clearly identifiable stage in the production process results in an improvement of the reaction to fire classification (e.g. an addition of fire retardants or a limiting of organic material)

** Products/materials not covered by footnote (*)

*** Products/materials that do not require to be tested for reaction to fire (e.g. products/materials of class A1 according to Commission Decision 96/603/EC, as amended)

⁵ Official Journal of the European Communities no. L 178, 14.7.1999, p. 52

⁶ Official Journal of the European Communities no. L 209, 2.8.2001, p. 33

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with the Technical Assessment Body Österreichisches Institut für Bautechnik.

The notified product certification body shall visit the factory at least twice a year for surveillance of the manufacturer.

Issued in Vienna on 23.08.2018
by Österreichisches Institut für Bautechnik

The original document is signed by:

Rainer Mikulits
Managing Director

electronic copy
electronic copy
electronic copy
electronic copy
electronic copy
electronic copy

electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy

1 General

- > “ZZ C30” can be used in apertures in walls (vertical separating element) and floors (horizontal separating element) according to clause 2.1 of the ETA.
- > The penetration of cables according to clause 2.1 of the ETA is permitted.
- > The total cross section of the installations must not be more than 60 % of the opening size of the penetration seal.

1.1 Service support constructions

- > All types of cables – in flexible walls and rigid walls – have to be supported on both side of the separating element by steel cable trays (perforated or non-perforated), steel ladders or alternative service support constructions (e.g. pipe hangers) made of metal with a melting or decomposition point greater or equal than 1006 °C for EI 90 or 1049 °C for EI 120 (e.g. stainless steel or galvanized steel) according to the ETA-holder’s installation instructions.
- > All types of cables – in rigid floors – have to be supported at least on the top side of the separating element by steel cable trays (perforated or non-perforated), steel ladders or alternative service support constructions (e.g. pipe hangers) made of metal with a melting or decomposition point greater or equal than 1006 °C for EI 90 or 1049 °C for EI 120 (e.g. stainless steel or galvanized steel) according to the ETA-holder’s installation instructions.
- > Steel cable trays (perforated or non-perforated), steel ladders and lidded cable trays / trunkings must not pass through the penetration seal.
- > The first support (service support construction) for cables in flexible walls and rigid walls has to be at maximum 200 mm (measured from the surface of the penetration seal).
- > The first support (service support construction) for cables in rigid floors has to be at maximum 250 mm (measured from the surface of the penetration seal).
- > All types of cables have to be fixed according to the ETA-holder’s installation instructions to the service support construction.

ZZ C30

- Details for installation -

ANNEX A-1

electronic copy electronic copy

2 Details for installation of “ZZ C30” (see Annex B-1 to D-1 of the ETA)

- > “ZZ C30” has to be installed according to the ETA-holder’s installation instructions.
- > “ZZ C30” will be formed by filling “ZZ 333” on both sides in the opening of the separating element so that all interstices and voids are carefully sealed.
- > It is possible to use formwork for the installation of “ZZ C30” in walls and floors. If the formwork consists of cardboard (thickness 3 mm), adhesive tape or PE round cord, it may remain within the cable penetration seal.

2.1 Details for installation in flexible wall constructions (see Annex B-1 of the ETA)

- > For walls thinner than the minimum thickness of the penetration seal (150 mm – for fire resistance class EI 120; see Annex B-1 of the ETA) the aperture within the wall shall be lined with minimum 2 layers of $\geq 12,5$ mm thick type F gypsum boards according to EN 520 (classification A2-s1,d0 according to EN 13501-1) or silicate- or calcium silicate boards (classification A1 according to EN 13501-1) with a minimum density of 450 kg/m^3 and a minimum thickness of 25 mm. The boards shall be at least 150 mm (see Annex B-1 of the ETA) wide. The boards have to be installed and fixed according to the ETA-holder’s installation instructions.
- > Alternatively the thickness of the wall can be increased to at least 150 mm (for fire resistance class EI 120) by fitting a board frame, minimum 50 mm wide, around the opening (see Annex B-1 of the ETA). Minimum 1 layer of $\geq 12,5$ mm thick type F gypsum boards according to EN 520 (classification A2-s1,d0 according to EN 13501-1) or silicate- or calcium silicate boards (classification A1 according to EN 13501-1) with a minimum density of 450 kg/m^3 can be used. The board frame has to be installed and fixed according to the ETA-holder’s installation instructions.
- > When no aperture lining is necessary (in case the thickness of the wall is equal to the thickness of penetration seal (≥ 150 mm)) or a board frame is used, the whole cavity within the wall has to be filled with material wool (stone wool with classification A1 according to EN 13501-1, a minimum apparent density of 40 kg/m^3 and a melting point $\geq 1000 \text{ }^\circ\text{C}$ according to DIN 4102-17) minimum 100 mm around the aperture.
- > Joints between the aperture lining and the aperture have to be filled with “ZZ 333” or gypsum joint filler (non-combustible material with classification A2-s1,d0 or A1 according to EN 13501-1 which is dimensionally stable) on both sides of the penetration seal according to the ETA-holder’s installation instructions.

ZZ C30 - Details for installation -	ANNEX A-2
--	------------------

electronic copy electronic copy

3 Minimum working clearances

- > The minimum working clearances (a1) and the minimum clearance between the penetration seals are specified in Annex B-1 to C-1 of the ETA.

4 Subsequent addition (retrofitting) and removal

- > Subsequent addition (retrofitting) and removal of cables according to the ETA holder's installation instructions is permitted.
- > Retrofitting and removal without addition of cables shall be done according to the ETA holder's installation instructions and the regulations of Annex A-2, clause 2 of the ETA.
- > After removal without addition of cables the remaining opening (hole) has to be closed with "ZZ 333" according to the ETA-holder's installation instructions.

5 Transport and storage

- > The indications of the manufacturer regarding transport and storage (minimum and maximum storing temperature, maximum duration of storage) have to be followed.

6 Use, maintenance and repair

- > The fire resistance of the penetration seal shall not be negatively affected by future changes to buildings or building elements.
- > The assessment of the fitness for use is based on the assumption that necessary maintenance and repair if required is carried out in accordance with the manufacturer's instructions during the assumed intended working life.


<p style="text-align: center;">ZZ C30 - Details for installation -</p>	<p style="text-align: center;">ANNEX A-4</p>
--	---

View:

Lining (min. two layers of gypsum board of thickness $\geq 12,5$ mm or min. one layer of silicate/calcium silicate board of thickness ≥ 25 mm), alternatively frame made from gypsum board or silicate/ calcium silicate board ≥ 50 mm width around the opening (see ANNEX A-2 of the ETA)

Cables

Fixing according to the ETA - holder's installation instruction

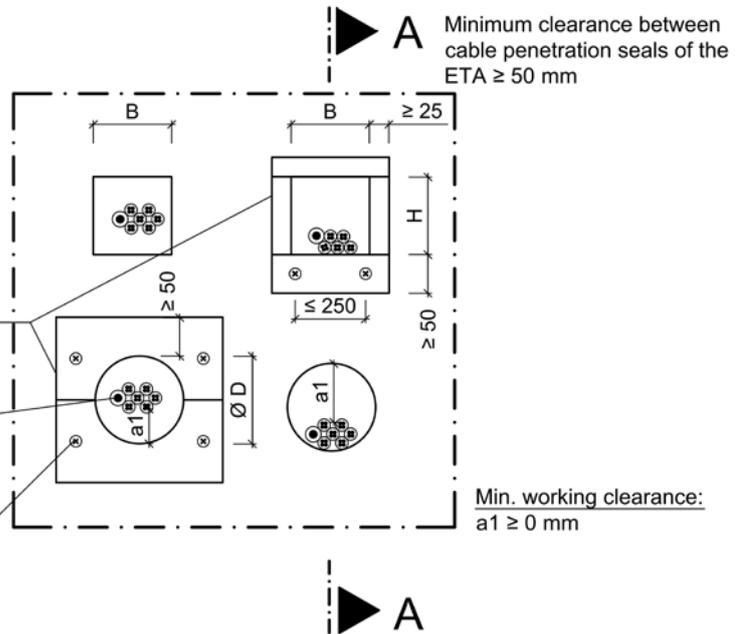

Cross Section A-A:

Lining made from gypsum board, or silicate/ calcium silicate board


Flexible wall

Increase the thickness of the wall either on one or on both sides to at least min. seal thickness by fitting a board frame (≥ 50 mm wide) around the opening

Cables

Service support construction (see ANNEX A-1 of the ETA)

"ZZ 333"

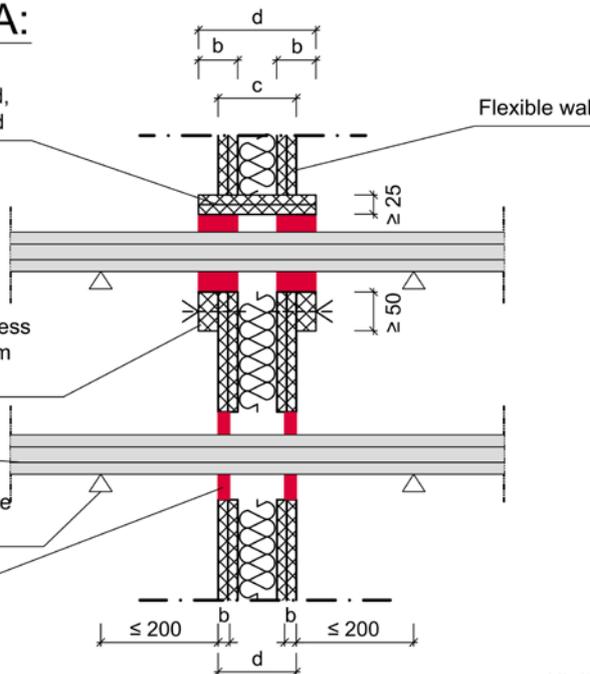

All dimensions in mm


Separating element	Fire resistance classification	Wall thickness c [mm]	Max. opening size H [mm] x B [mm] / \varnothing D [mm]	Thickness of penetration seal d [mm]
Flexible wall	see ANNEX D-1 of the ETA	≥ 94	$\leq 100 \times \leq 100 / \varnothing \leq 113$	$\geq 100 / b \geq 15$ or $\geq 150 / b \geq 50$ see ANNEX D-1 of the ETA

ZZ C30


- Installation in flexible wall, thickness $c \geq 94$ mm -

ANNEX B-1

View:

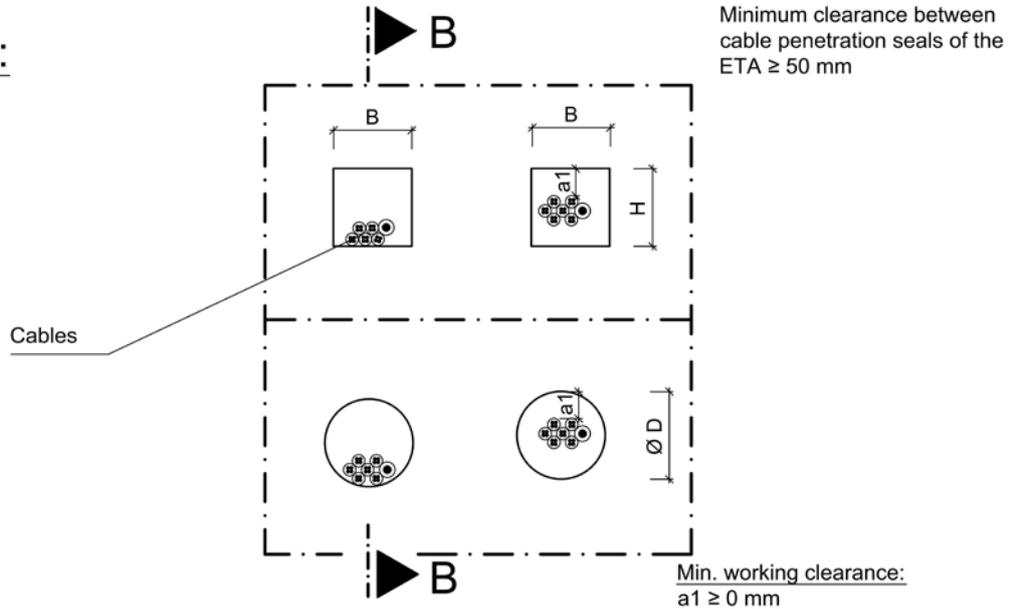

Cross Section B-B:

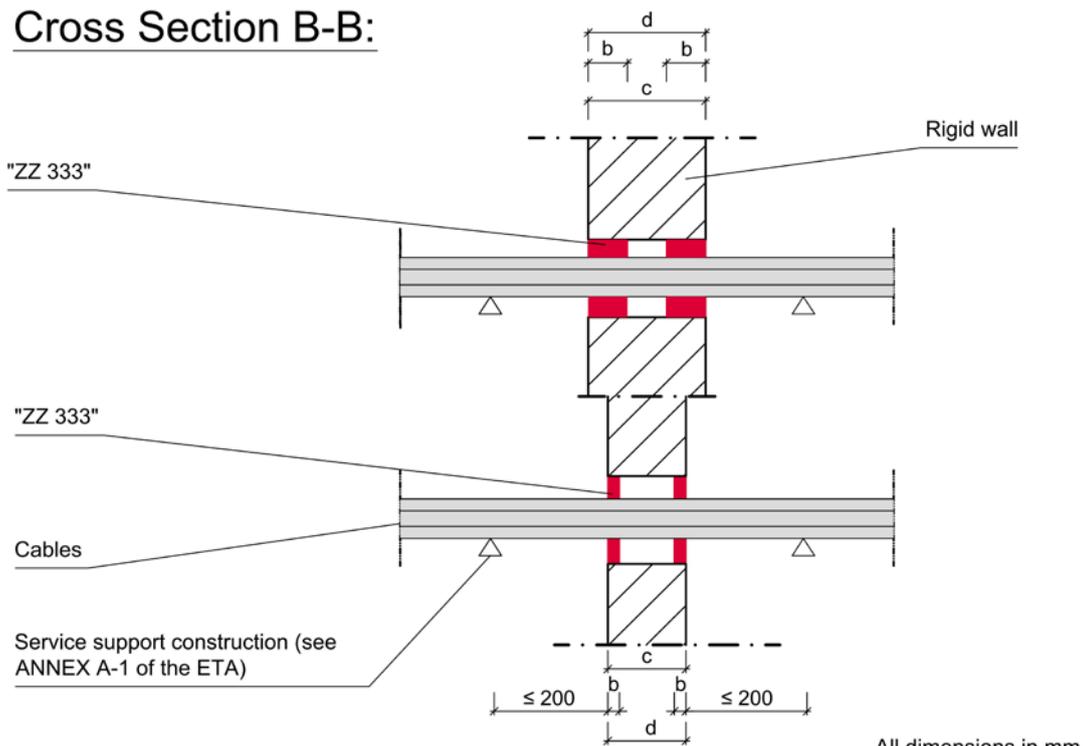

Separating element	Fire resistance classification	Wall thickness c [mm]	Max. opening size H [mm] x B [mm] / $\varnothing D$ [mm]	Thickness of penetration seal d [mm]
Rigid wall	see ANNEX D-1 of the ETA	$c \geq d$	≤ 100 x ≤ 100 / $\varnothing \leq 113$	≥ 100 / $b \geq 15$ or ≥ 150 / $b \geq 50$ see ANNEX D-1 of the ETA

ZZ C30

- Installation in rigid wall, thickness $c \geq d$ -


ANNEX B-2

electronic copy

View:

Lining (min. two layers of gypsum board of thickness $\geq 12,5$ mm or min. one layer of silicate/calcium silicate board of thickness ≥ 25 mm), alternatively frame made from gypsum board or silicate/ calcium silicate board ≥ 50 mm width around the opening (see ANNEX A-3 of the ETA)

Fixing according to the ETA - holder's installation instruction

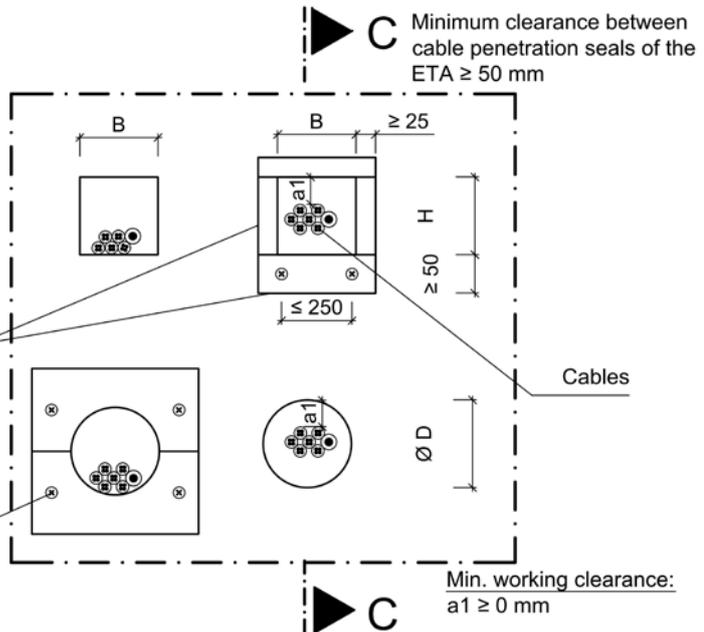

Cross Section C-C:


Lining made from gypsum board, or silicate/ calcium silicate board

Increase the thickness of the wall either on one or on both sides to at least min. seal thickness by fitting a board frame (≥ 50 mm wide) around the opening

"ZZ 333"

Cables

Service support construction (see ANNEX A-1 of the ETA)

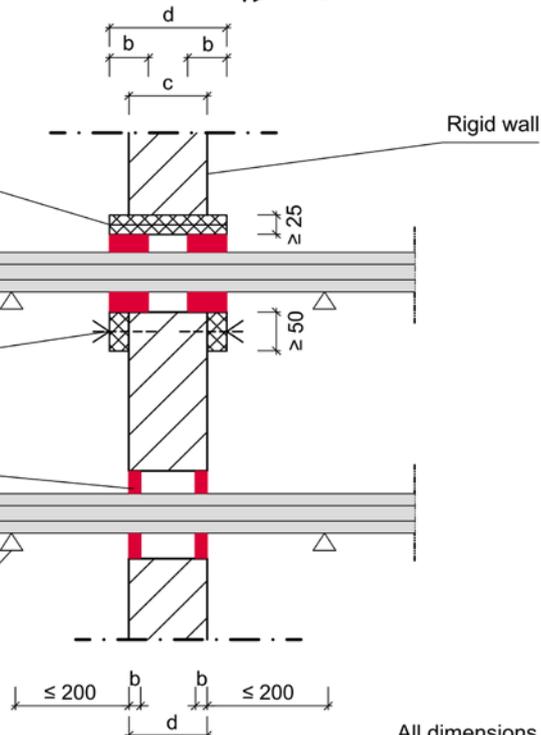

All dimensions in mm


Separating element	Fire resistance classification	Wall thickness c [mm]	Max. opening size H [mm] x B [mm] / Ø D [mm]	Thickness of penetration seal d [mm]
Rigid wall	see ANNEX D-1 of the ETA	$100 \leq c < 150$	$\leq 100 \times \leq 100 / \leq 113$	$\geq 100 / b \geq 15$ or $\geq 150 / b \geq 50$ see ANNEX D-1 of the ETA

ZZ C30


- Installation in rigid wall, thickness $100 \text{ mm} \leq c < 150 \text{ mm}$ -

ANNEX B-3

Top View:

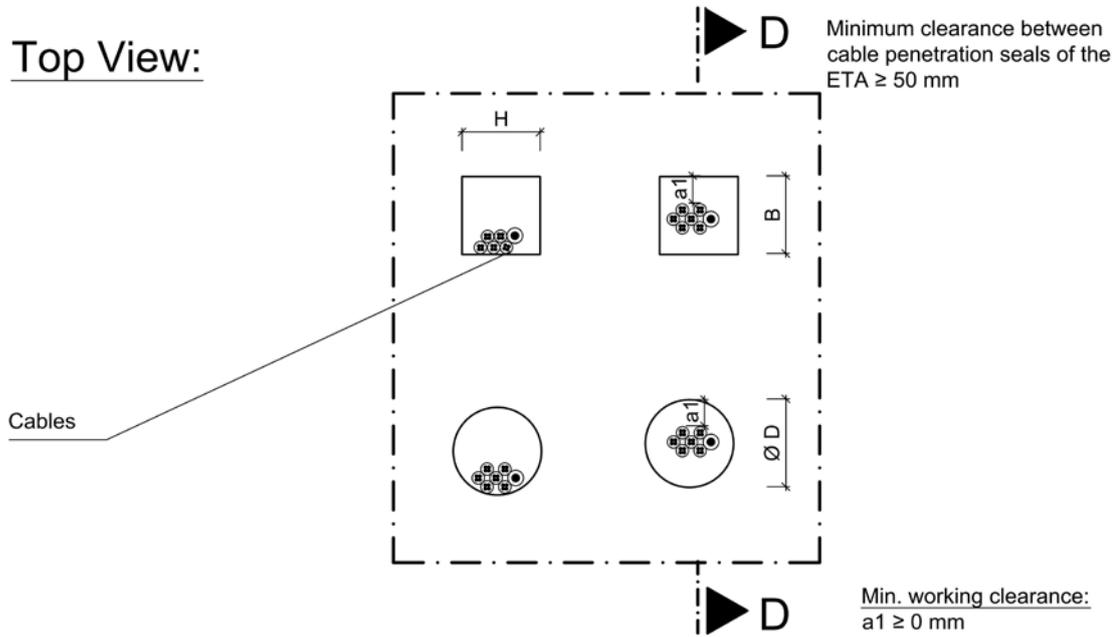

Cross Section D-D:

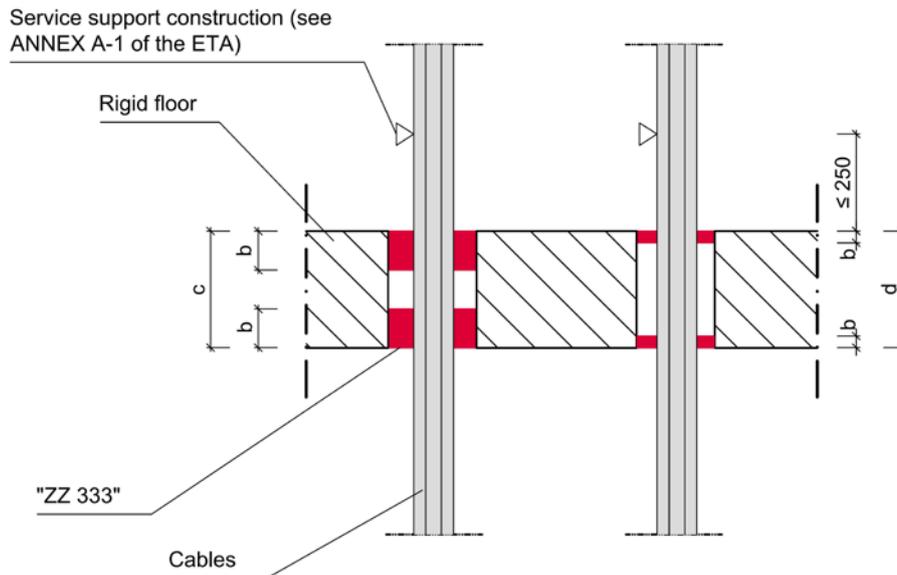

All dimensions in mm

Separating element	Fire resistance classification	Floor thickness c [mm]	Max. opening size H [mm] x B [mm] / Ø D [mm]	Thickness of penetration seal d [mm]
Rigid floor	see ANNEX D-1 of the ETA	$c \geq 150$	$\leq 100 \times \leq 100 / \leq 113$	$\geq 100 / b \geq 15$ or $\geq 150 / b \geq 50$ see ANNEX D-1 of the ETA

ZZ C30

- Installation in rigid floor, thickness $c \geq 150$ mm -

ANNEX C-1

